


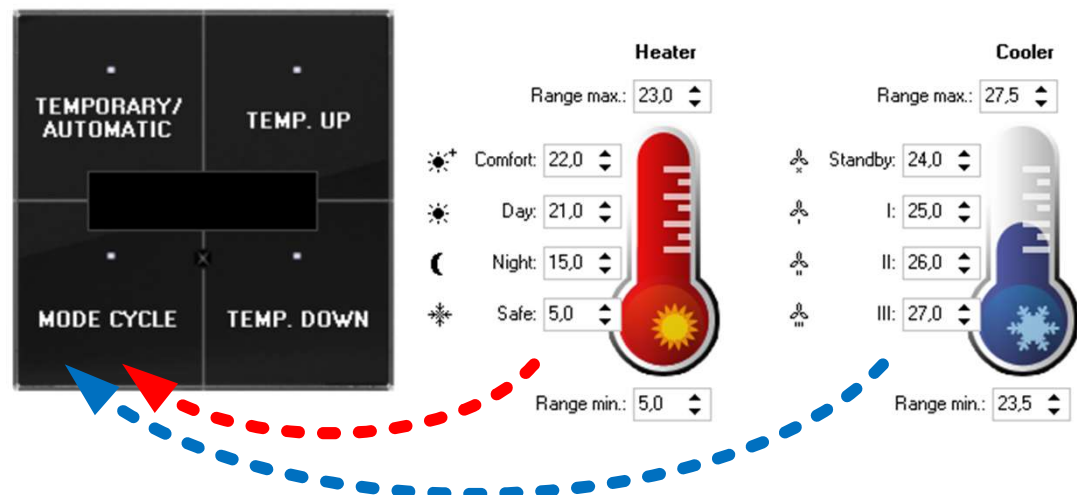

Sensors	Presets	Alarms	Advanced	Local control
Alarm 1				
When?	Temperature below	fixed temperature	25,0	°C
Alarm 2				
When?	Temperature above	fixed temperature	25,0	°C
Alarm 3				
When?	Temperature below	fixed temperature	15,0	°C

Operational Alarm settings

Touch Panel	Temperature	Energy counters	Analog sensors	Progr
Alarm 1				
When?	Temperature below	fixed temperature	21,0	°C
Alarm 2				
When?	Temperature below	fixed temperature	20,5	°C
Alarm 3				
When?	Temperature above	fixed temperature	25,5	°C
Alarm 4				
When?	Temperature above	fixed temperature	26,5	°C

121. Heating mode
→ VMB4RYLD Ch4. **HEAT**

122. Cooling mode

104. Momentary → VMB4RYLD Ch1. **LOW**

104. Momentary → VMB4RYLD Ch1. **MEDIUM**


104. Momentary → VMB4RYLD Ch1. **LOW**

104. Momentary → VMB4RYLD Ch1. **MEDIUM**

15°	HIGH fan speed
16°	HIGH fan speed
17°	HIGH fan speed
18°	HIGH fan speed
19°	MEDIUM fan speed
20°	LOW fan speed
21°	LOW fan speed
22°	LOW fan speed
23°	LOW fan speed
24°	LOW fan speed
25°	OFF fan speed
26°	LOW fan speed
27°	MEDIUM fan speed
28°	HIGH fan speed

Heating mode ↑

Cooling mode ↓

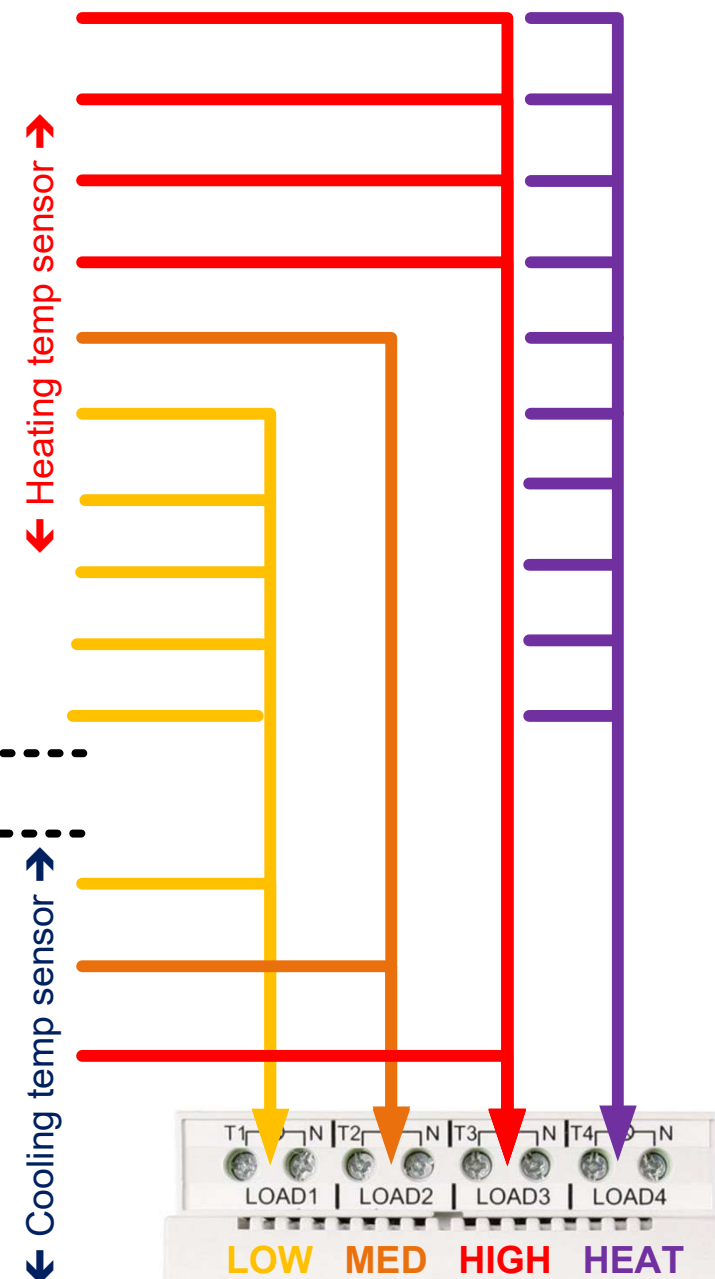

Heating temp sensor ↑

Cooling temp sensor ↓